


Mapbook location

PRIMARY CIRCUITS
Overhead & Underground
WITH OH SWITCH LOCATIONS

CIRCUIT
1207
Published 06/13/13










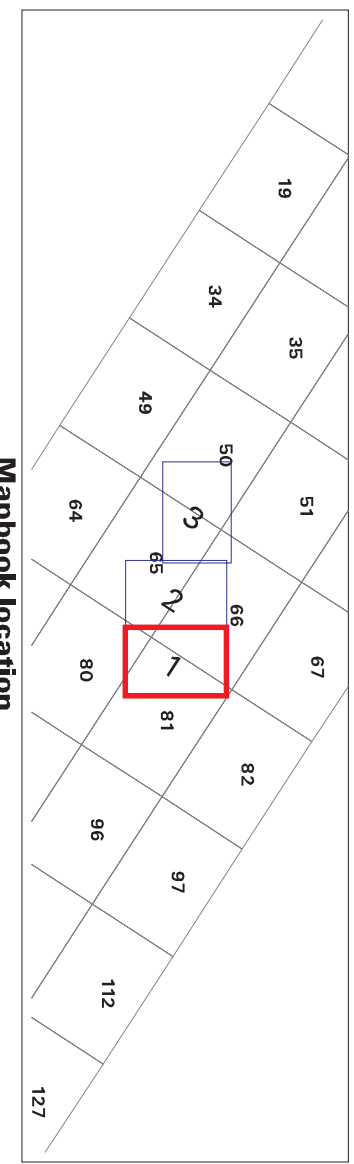

!! WARNING !!
This feeder is or may be occasionally connected to a cogeneration customer and is subject to back-energizing.
* Load Tap Changers
Contact the substation operating personnel for current switch positions

**12 KV
FREEMAN SUB
Auto Recloser**

**CIRCUIT
1207**

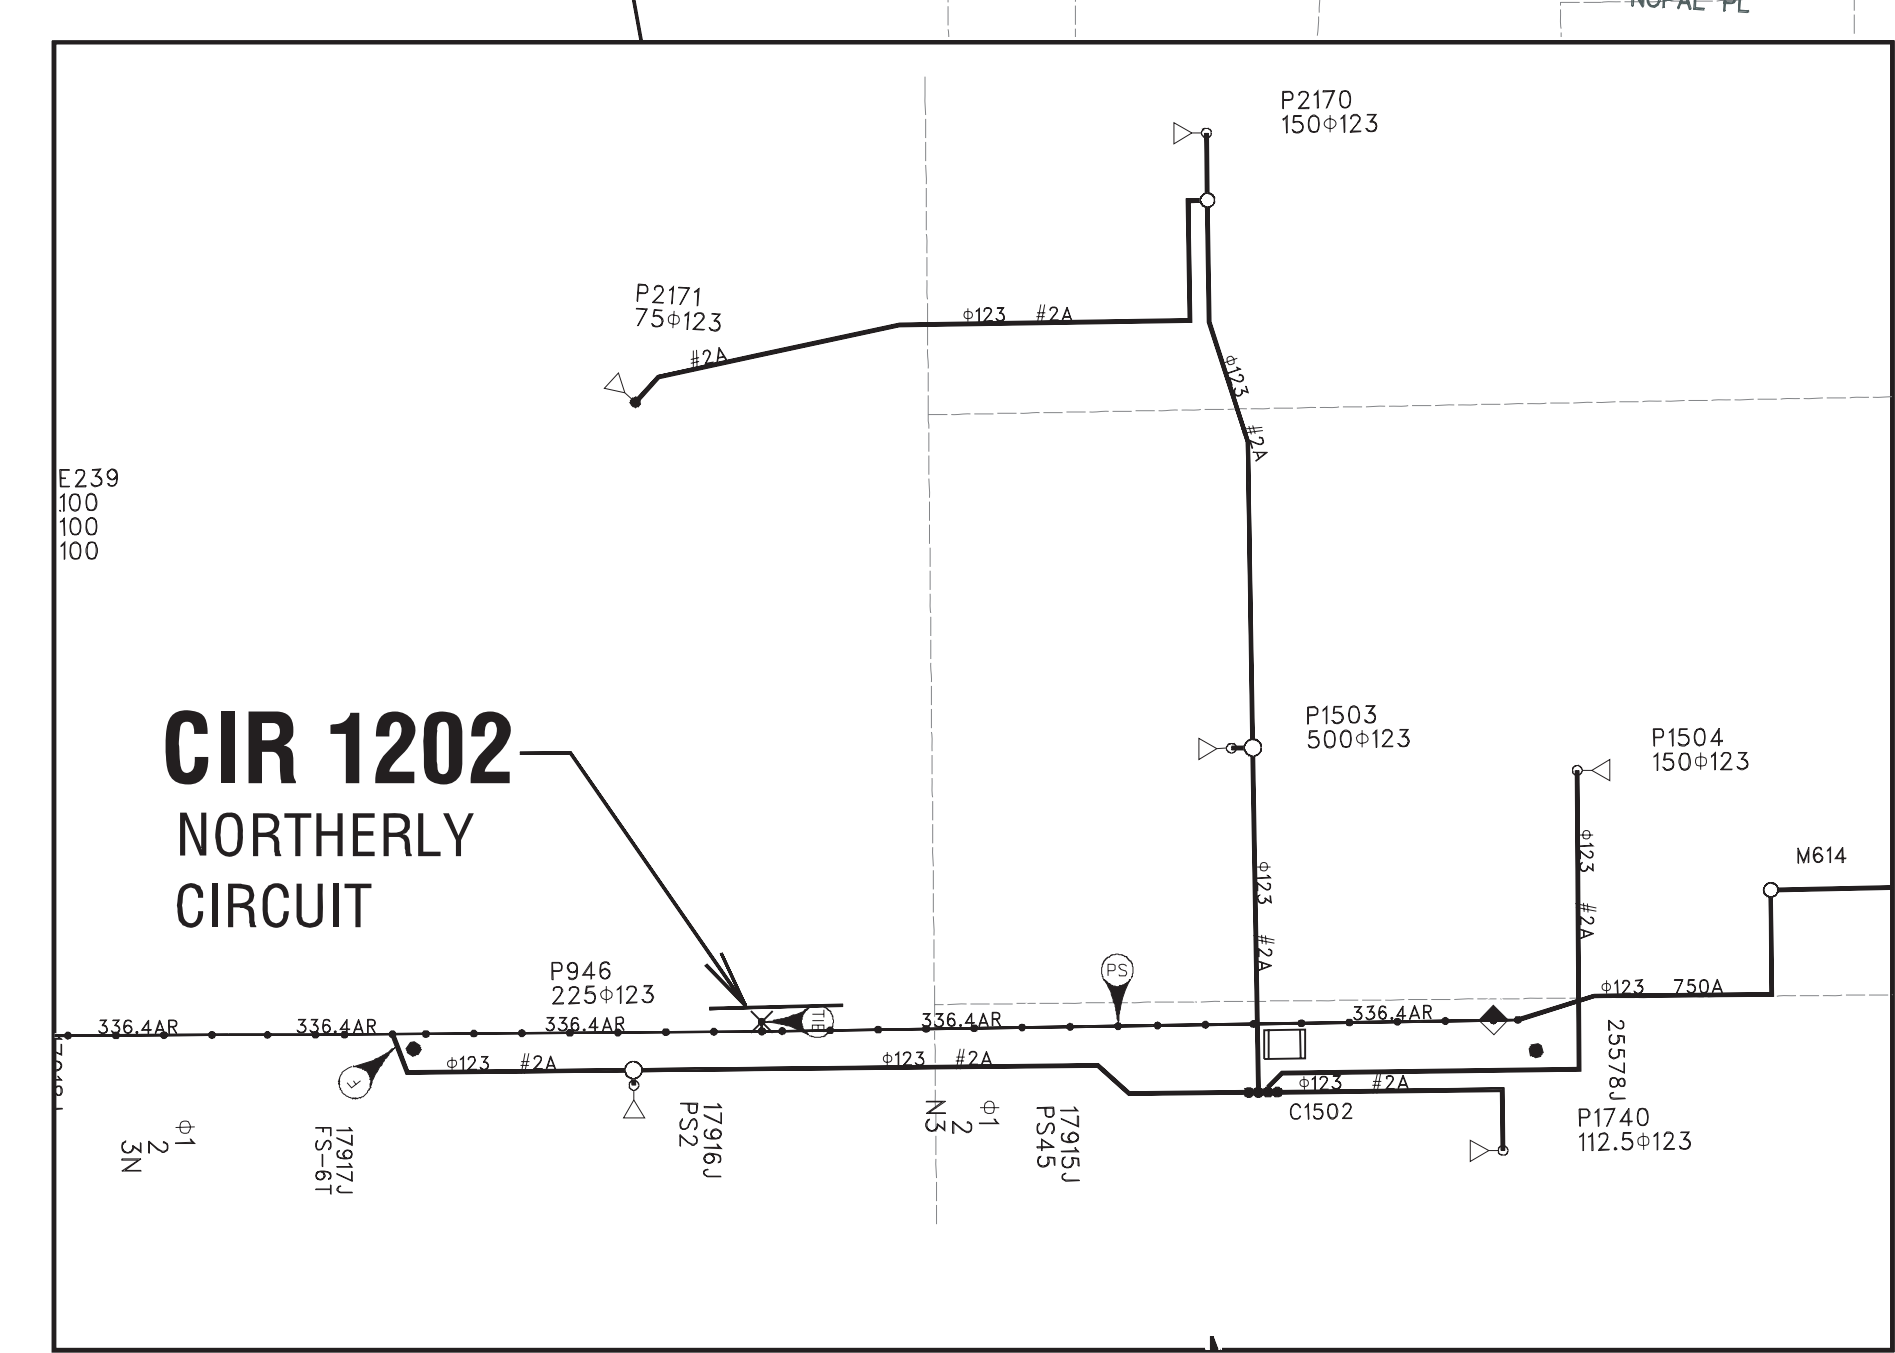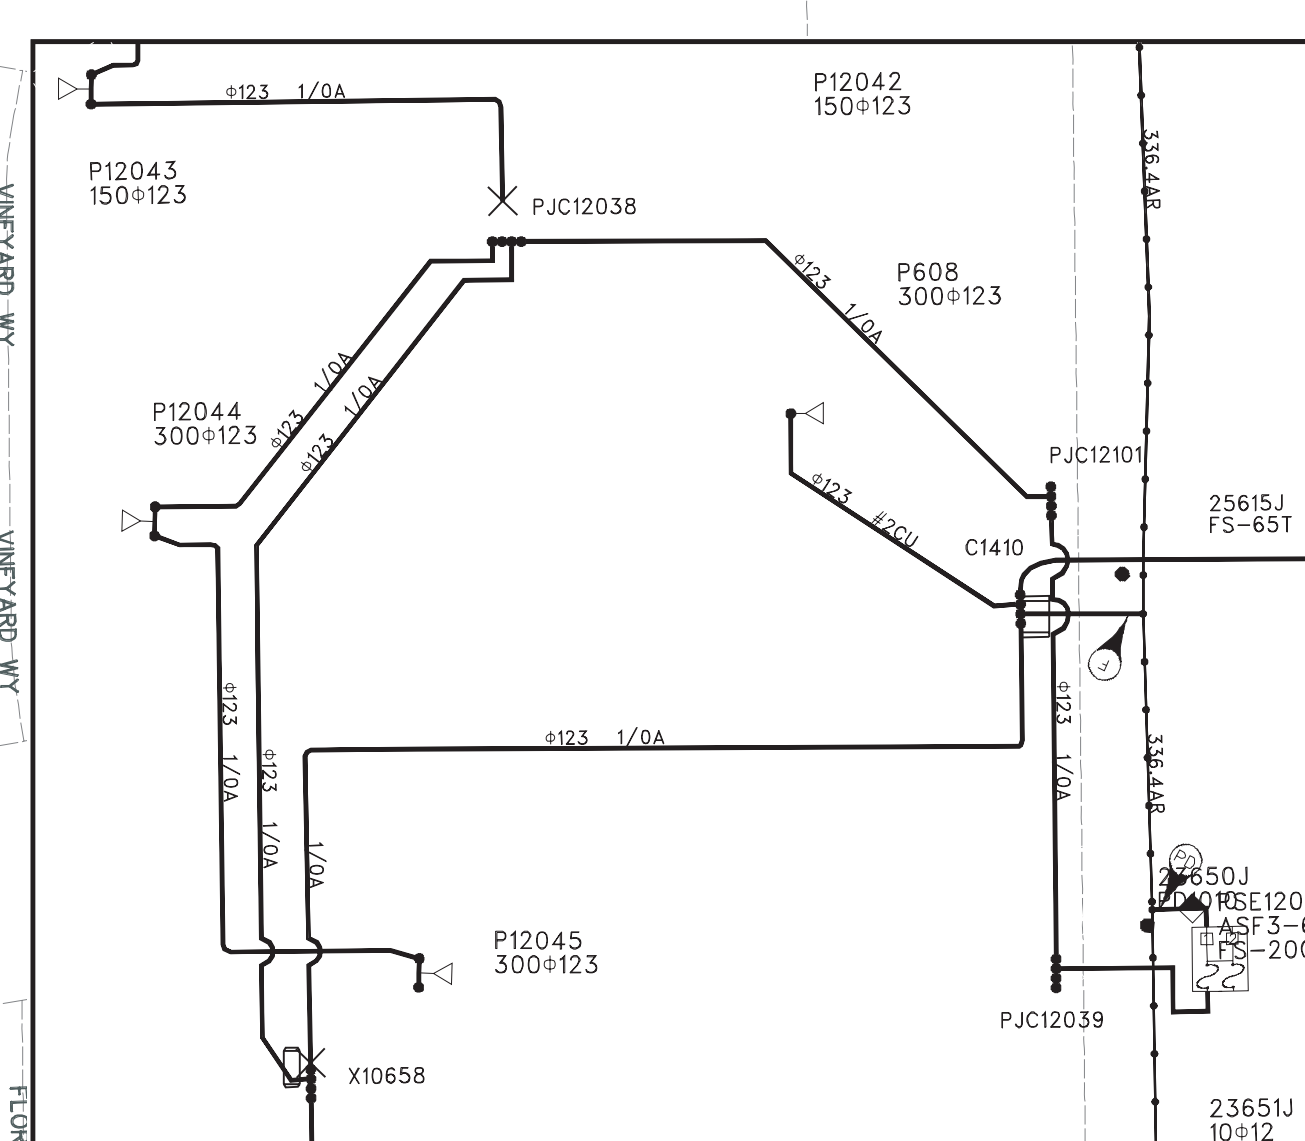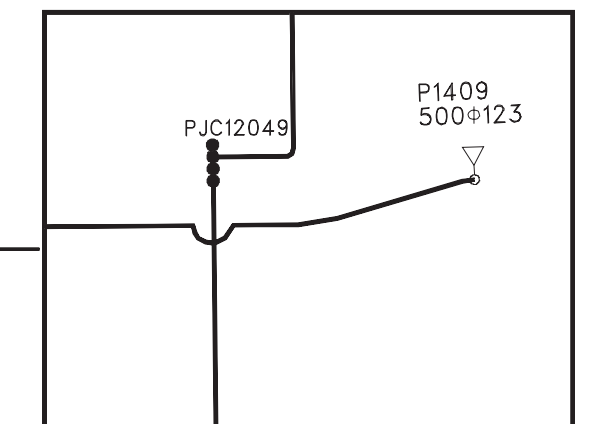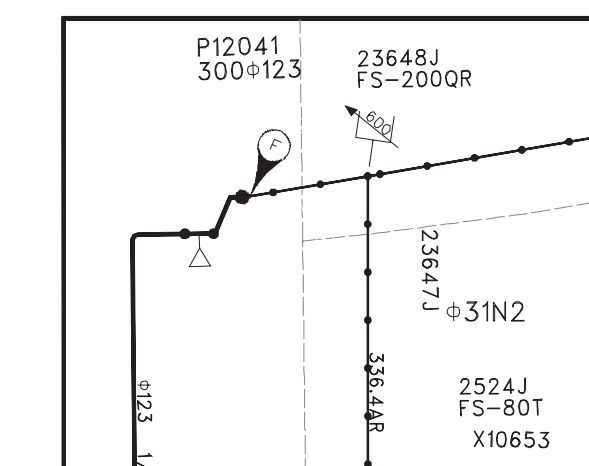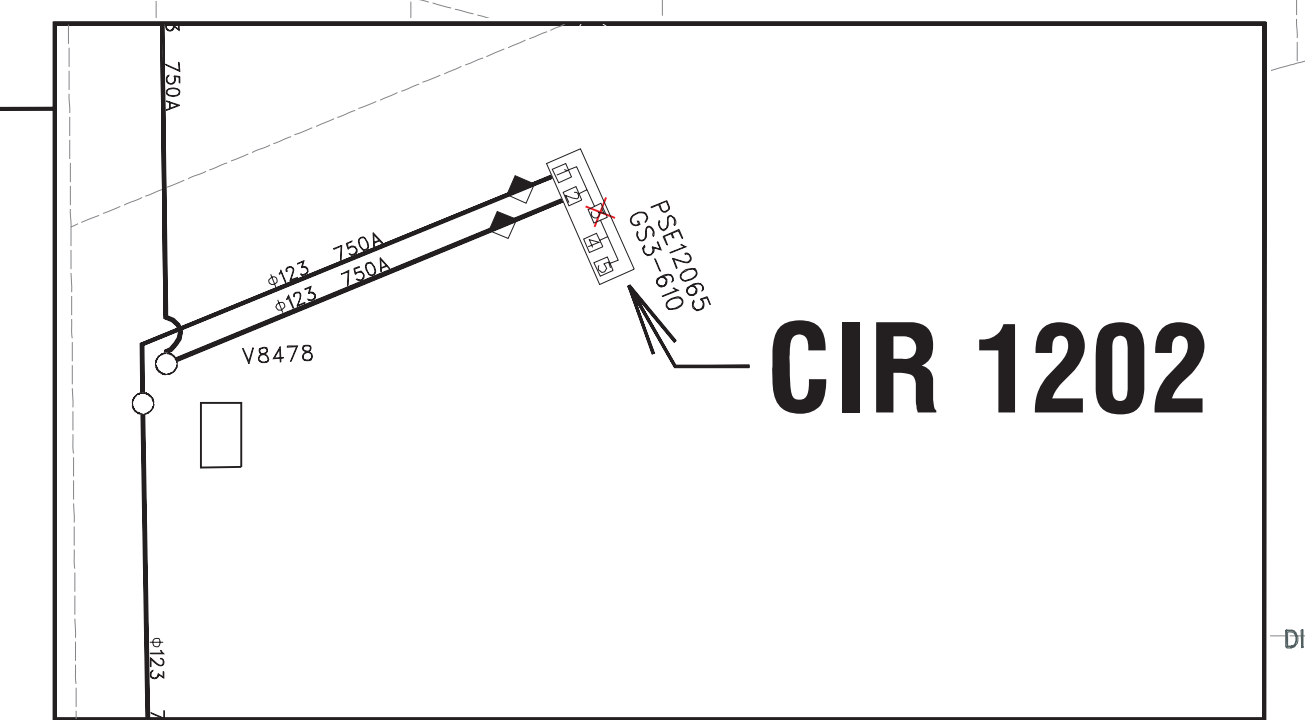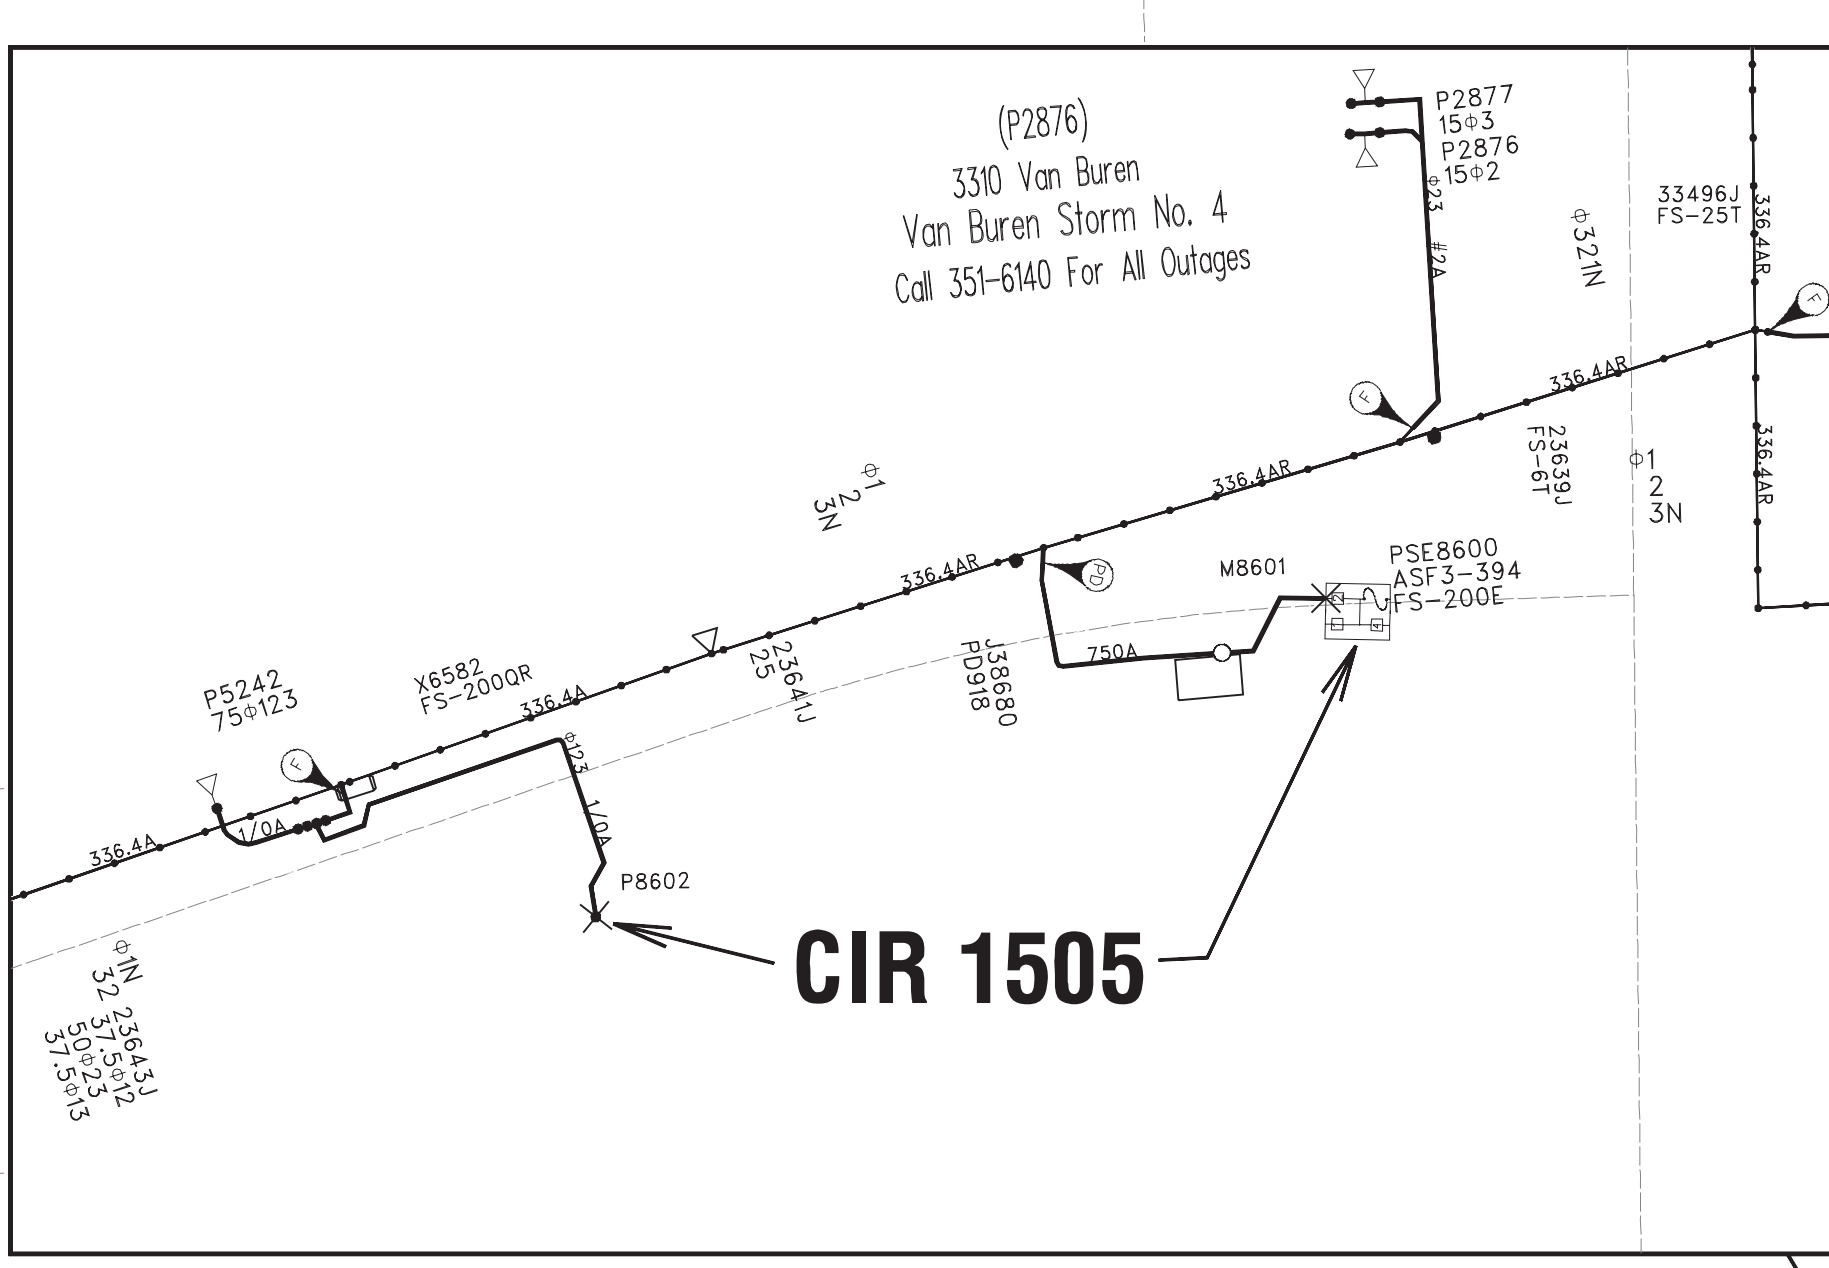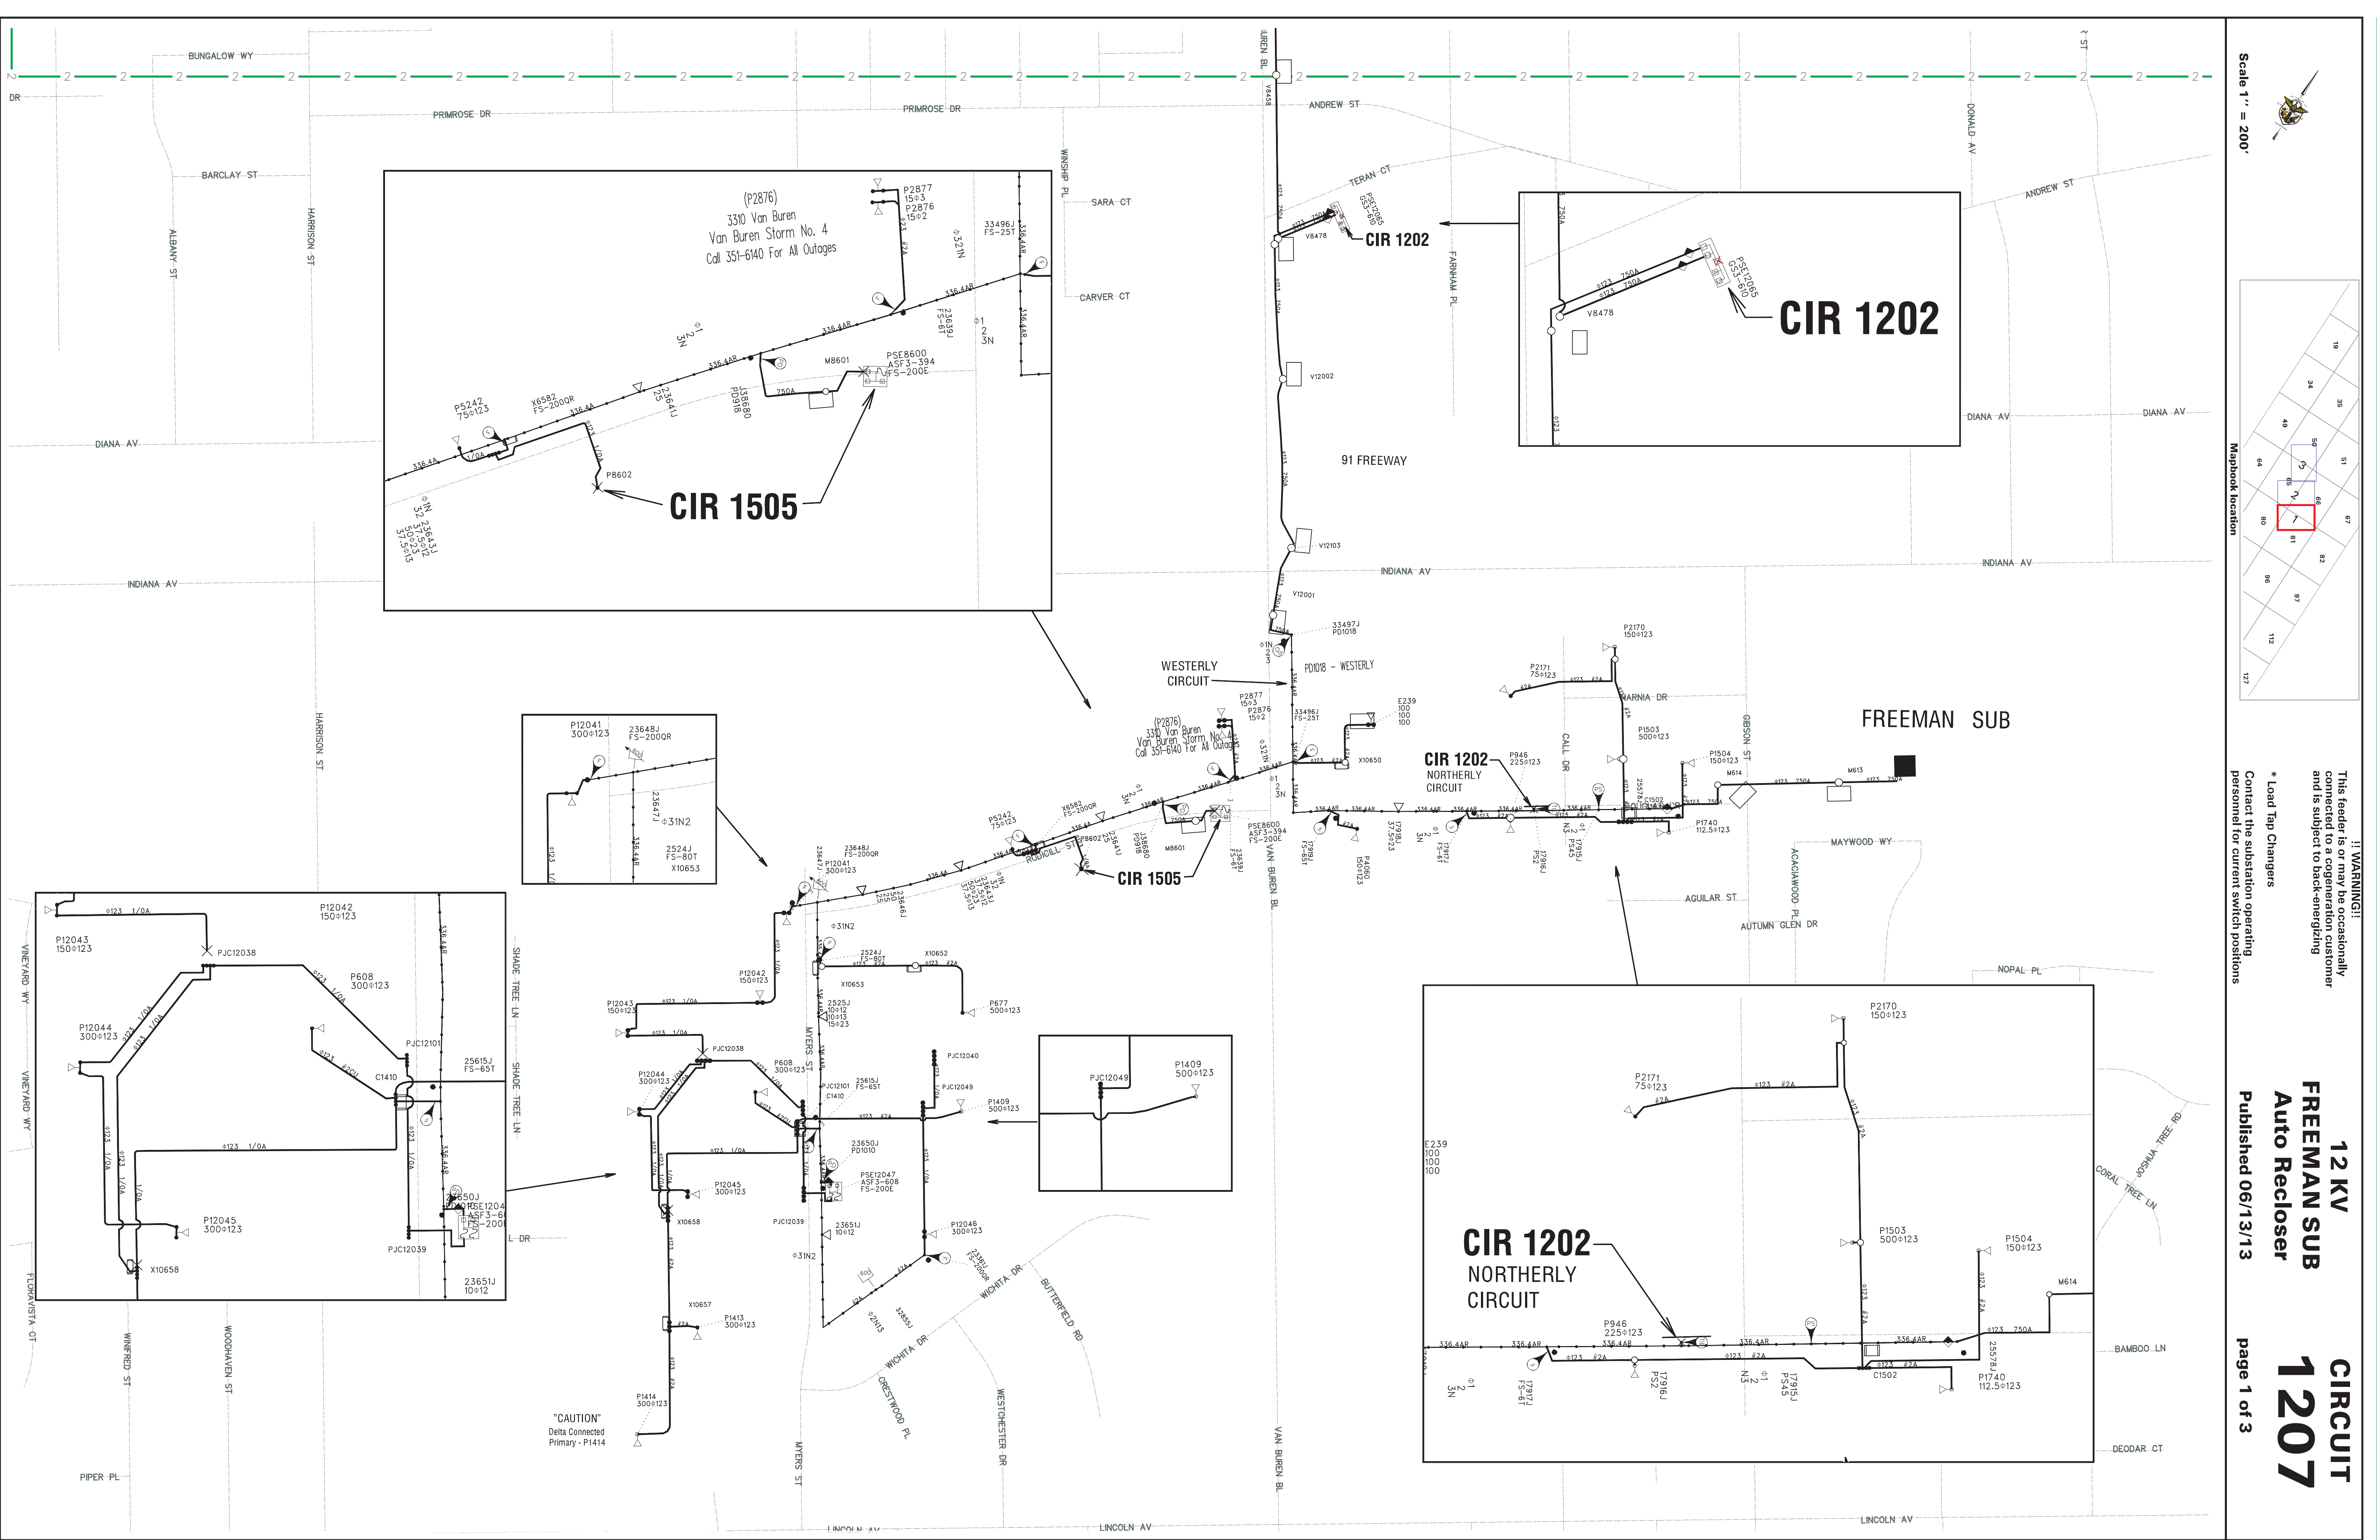


"CAUTION"
Delta Connected
Primary - P1414



Scale 1" = 200'


Mapbook location

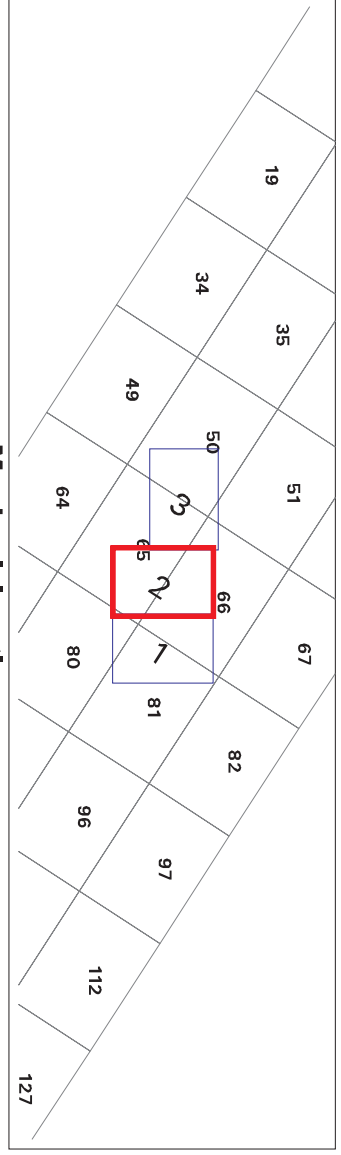


!! WARNING !!
This feeder is or may be occasionally connected to a cogeneration customer and is subject to back-energizing
* Load Tap Changers
Contact the substation operating personnel for current switch positions


12 KV
FREEMAN SUB
Auto Recloser
Published 06/13/13

CIRCUIT
1207
page 2 of 3

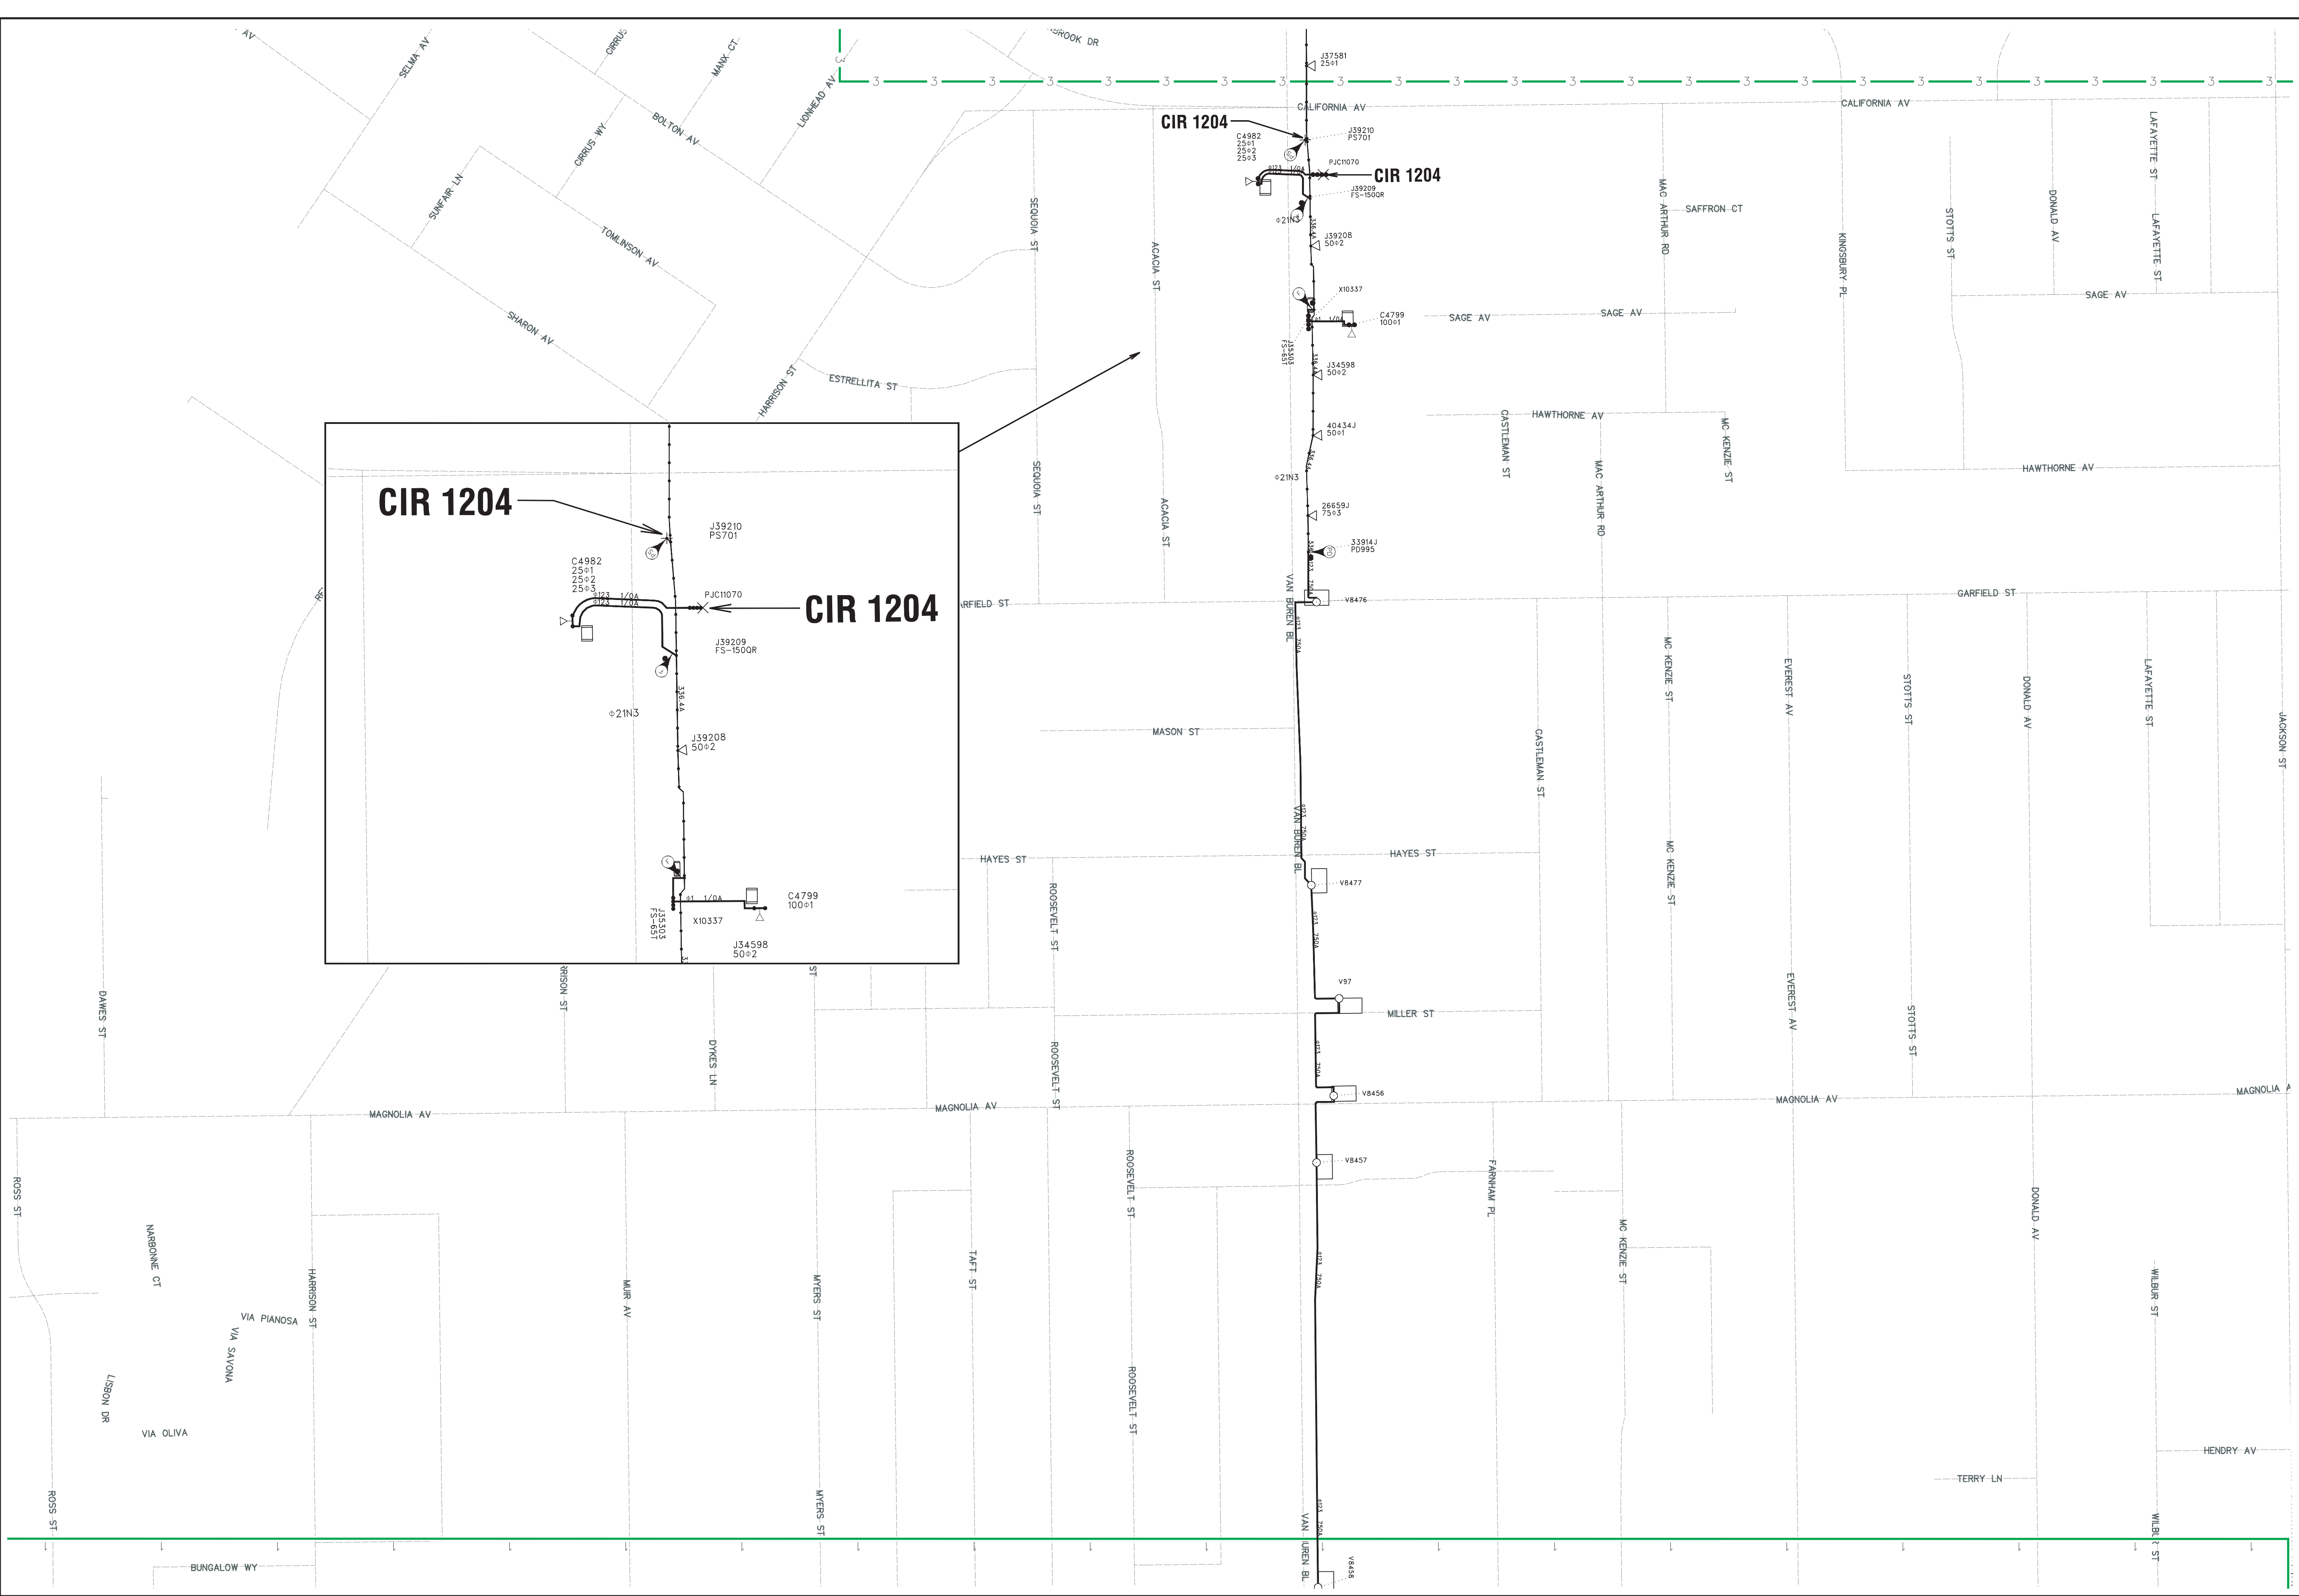



Scale 1" = 200'

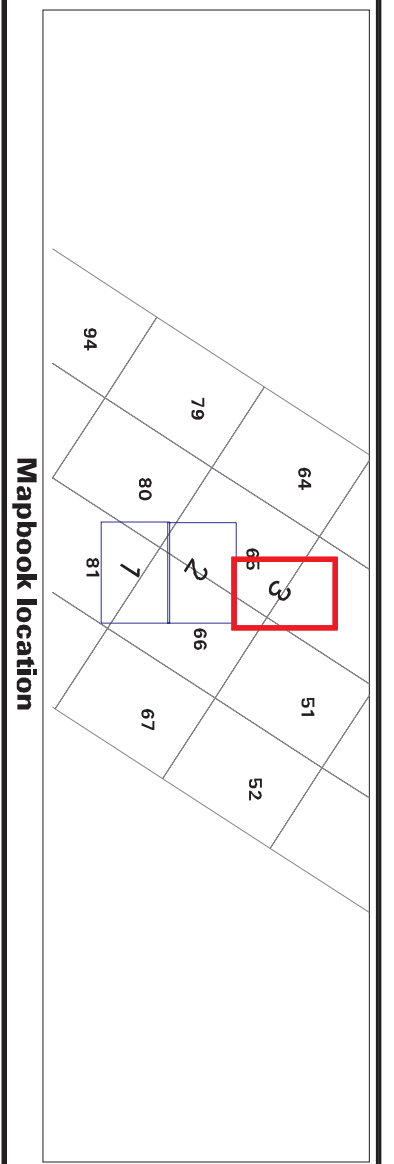

!! WARNING !!
This feeder is or may be occasionally connected to a cogeneration customer and is subject to back-energizing
* Load Tap Changers
Contact the substation operating personnel for current switch positions

**12 KV
FREEMAN SUB
Auto Recloser**

**CIRCUIT
1207**

Published 06/13/13

page 3 of 3

